


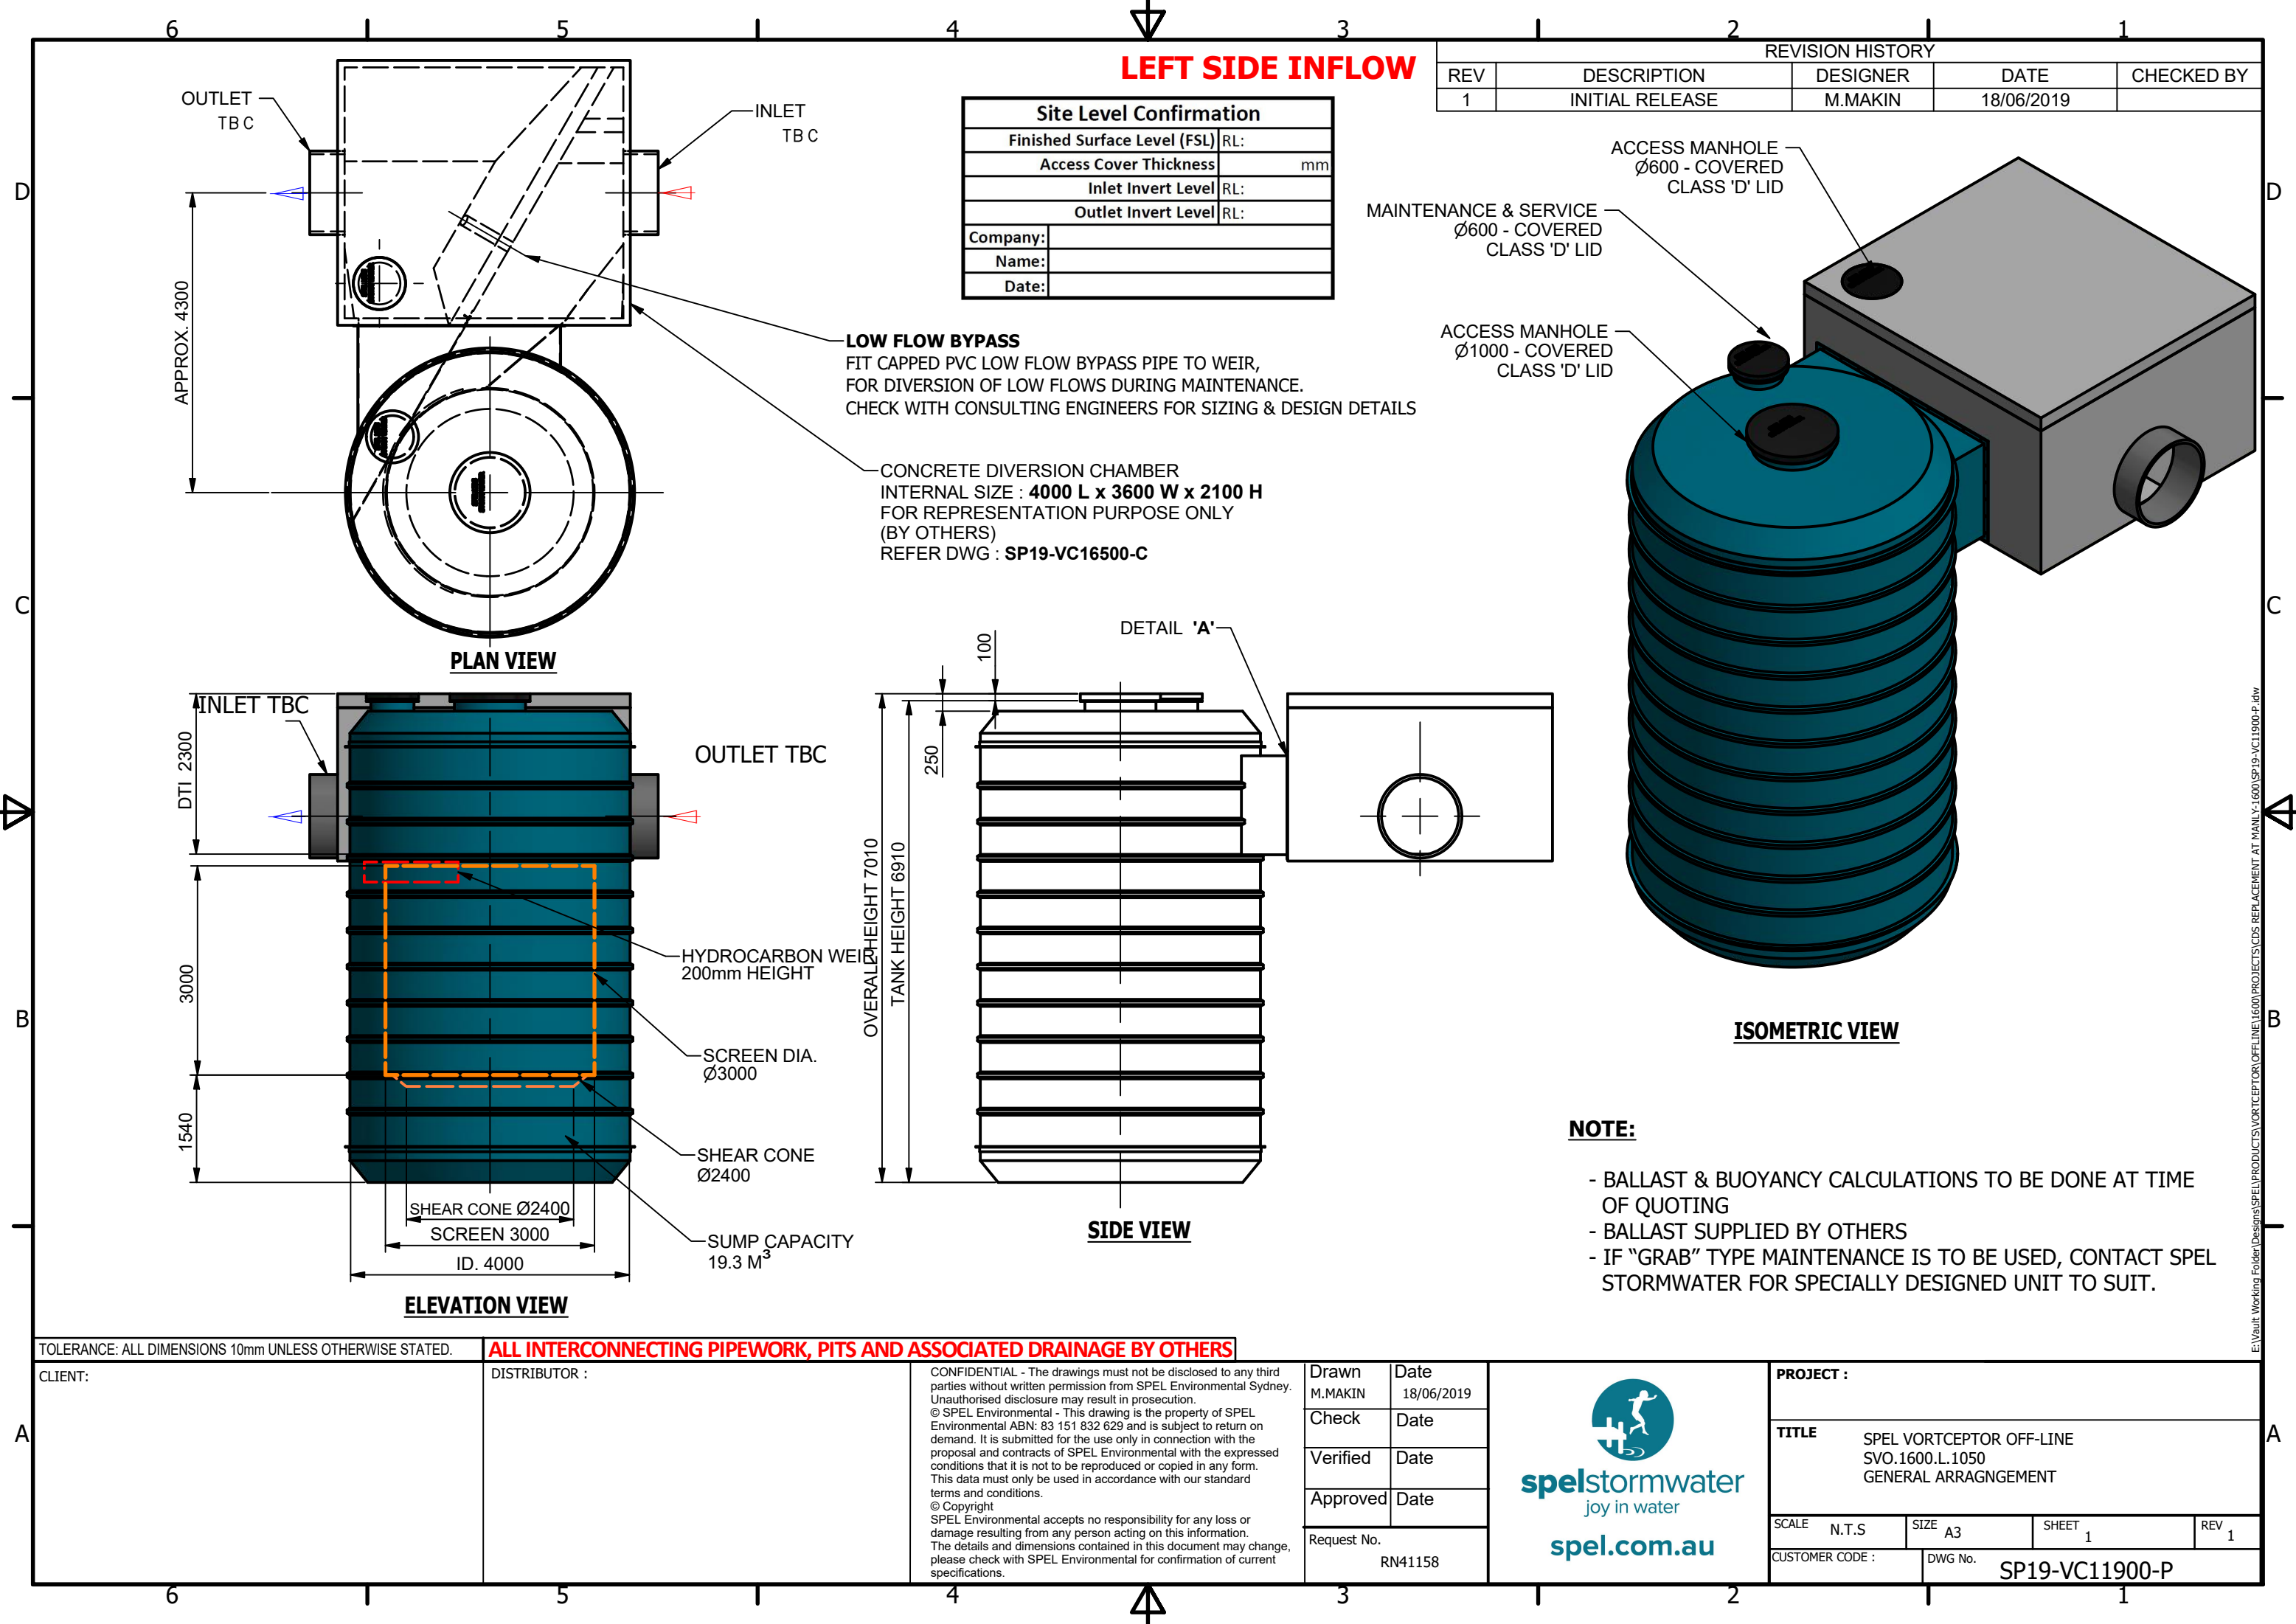

LEFT SIDE INFLOW

Site Level Confirmation	
Finished Surface Level (FSL)	RL:
Access Cover Thickness	mm
Inlet Invert Level	RL:
Outlet Invert Level	RL:
Company:	
Name:	
Date:	

REVISION HISTORY				
REV	DESCRIPTION	DESIGNER	DATE	CHECKED BY
1	INITIAL RELEASE	M.MAKIN	18/06/2019	

LOW FLOW BYPASS
FIT CAPPED PVC LOW FLOW BYPASS PIPE TO WEIR,
FOR DIVERSION OF LOW FLOWS DURING MAINTENANCE.
CHECK WITH CONSULTING ENGINEERS FOR SIZING & DESIGN DETAILS

CONCRETE DIVERSION CHAMBER
INTERNAL SIZE : 4000 L x 3600 W x 2100 H
FOR REPRESENTATION PURPOSE ONLY
(BY OTHERS)
REFER DWG : SP19-VC16500-C

ACCESS MANHOLE
Ø600 - COVERED
CLASS 'D' LID

MAINTENANCE & SERVICE
Ø600 - COVERED
CLASS 'D' LID

ACCESS MANHOLE
Ø1000 - COVERED
CLASS 'D' LID

ISOMETRIC VIEW

NOTE:

- BALLAST & BUOYANCY CALCULATIONS TO BE DONE AT TIME OF QUOTING
- BALLAST SUPPLIED BY OTHERS
- IF "GRAB" TYPE MAINTENANCE IS TO BE USED, CONTACT SPEL STORMWATER FOR SPECIALLY DESIGNED UNIT TO SUIT.

TOLERANCE: ALL DIMENSIONS 10mm UNLESS OTHERWISE STATED.		ALL INTERCONNECTING PIPEWORK, PITS AND ASSOCIATED DRAINAGE BY OTHERS		Drawn M.MAKIN		Date 18/06/2019	 spelstormwater joy in water spel.com.au	PROJECT :	
CLIENT:		DISTRIBUTOR :		Check		Date		TITLE	
				Verified		Date		SPEL VORTCEPTOR OFF-LINE SVO.1600.L.1050 GENERAL ARRANGEMENT	
				Approved		Date		SCALE	N.T.S.
				Request No.		RN41158		SIZE	A3
								SHEET	1
								REV	1
								CUSTOMER CODE :	DWG No.
								SP19-VC11900-P	